

PRECISION TEMPERATURE CONTROL FOR
OPTICS MANUFACTURING

Jeffrey W. Roblee

2nd International Technical Symposium on
Optical and Electro-Optical
Applied Science and Engineering
Cannes, France
November 25-29, 1985

November, 1985



Lawrence
Livermore
National
Laboratory

This is a preprint of a paper intended for publication in a journal or proceedings. Since changes may be made before publication, this preprint is made available with the understanding that it will not be cited or reproduced without the permission of the author.

DISCLAIMER

This document was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor the University of California nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial products, process, or service by trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or the University of California. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or the University of California, and shall not be used for advertising or product endorsement purposes.

Precision Temperature Control for Optics Manufacturing

by

Jeffrey W. Roblee

Lawrence Livermore National Laboratory
P. O. Box 808, L-792, Livermore, California 94550

Abstract

The principles of precision temperature control are presented in this paper. Emphasis is placed on the use of heat exchangers with large flowrates of coolant. Design considerations for such systems are highlighted. In particular, the selection of system components appropriate to the desired level of performance is discussed. Several feedback control techniques are also presented.

Introduction

One of the largest sources of inaccuracy in optical components arises from thermally induced distortions. These can occur in the manufacture, inspection, and assembly of optical components. A number of techniques are presented for achieving temperature control at appropriate levels of precision. The emphasis is on the design principles required for constructing a system for supplying temperature controlled coolant to a machine or instrument. The specific details of how that coolant is used are not discussed. A number of practical, precision feedback control techniques are presented, and alternative system designs, consisting of commercially available components, are discussed.

At the Lawrence Livermore National Laboratory (LLNL), precise diamond turning machines are brought to a thermal equilibrium (and maintained there) by using massive flows of temperature controlled air and liquids. Bryan^{1,2} has used external oil showers on machine tools to greatly improve their thermal stability and others^{3,4} have used air showers. Other machines at LLNL^{5,6} combine an external air shower with internal water cooling in areas of concentrated heating. Air showers are not effective for removing large quantities of heat, but they are convenient for minimizing the influence of external heat sources on structures with negligible internal heating. For most applications, a thermal gradient in a structure is permissible, as long as it is stable with respect to time. Therefore, all heat loads on precision machines should be made as constant as possible. It is the suppression of time-varying heat loads that determines the amount of cooling required for a machine. However, if a short thermal "soak out" time is not necessary, critical structural elements should be insulated. This reduces their sensitivity to time-varying heat loads. The thermal response time of a machine also has a great impact on the temperature control system. It determines the frequency range over which the control system must perform. This implies that the required temperature stability of the machine coolant is frequency dependent, with large, high-frequency fluctuations being tolerable.

Heat Exchanger Design

At LLNL, the primary method for controlling machine-coolant temperature uses a chilled-water-cooled heat exchanger. This is true whether the machine coolant is air, water, oil, or some other fluid. Water, however, is an excellent coolant because of its high heat capacity and low viscosity. Both the flowrate and the temperature of the chilled water influence the machine-coolant temperature at the heat exchanger outlet. However, heat exchangers respond faster to flowrate changes, and flowrate is easier to manipulate than chilled-water temperature. Therefore, most systems at LLNL manipulate chilled-water flowrate to achieve temperature control, while holding the chilled-water temperature constant.⁶ By controlling a heat exchanger with this technique, the temperature control problem becomes one of flowrate control. Different flowrate-control methods are presented in the following section.

The design or selection of a heat exchanger is critical if precise temperature control is to be achieved. The following discussion focuses on liquid heat exchangers cooled by chilled water, but most of the comments are applicable to air heat exchangers as well. The static and dynamic characteristics of candidate heat exchangers must be examined to determine their ability to provide precise temperature control. This is complicated by the fact that the transient response and the steady-state heat transfer are a nonlinear function of chilled-water flowrate. The steady-state heat balance for a heat exchanger is given by the equation:

$$Q = UA \Delta T_m = C_p m (T_o - T_i)$$

where

- Q = heat load (energy/time)
- UA = overall heat transfer factor of the heat exchanger
- ΔT_m = logarithmic mean temperature difference across the heat exchanger
- C_p = specific heat of either fluid
- m = mass flowrate of either fluid
- T_o = bulk outlet temperature of either fluid
- T_i = bulk inlet temperature of either fluid

Here the bulk temperature is defined as the average temperature of a fluid, integrated across its cross section at a particular point in a pipeline. A typical solution to this equation is shown in Fig. 1. It indicates the chilled-water flowrate and temperature required to obtain a specified rate of heat transfer. For this example, it is assumed that the flowrate of the machine coolant is fixed and its outlet temperature is nominally 0°C. This type of a plot is very useful in the evaluation of candidate heat exchangers. For a constant inlet temperature, Equation 1 shows that a change in the heat transfer rate Q produces a proportional change in the outlet temperature of the machine coolant. Therefore, the slopes of the curves in Fig. 1 indicate the temperature sensitivity to flowrate errors at different chilled-water temperatures. For control system design, the slope also represents the input-output gain of the system, which ideally should be constant. However, the gain varies greatly with flowrate, with the steepest slope occurring at small flowrates. Also, the slope increases as the chilled-water temperature drops. Therefore, if the heat load is reduced, then the chilled water temperature can be raised to reduce the sensitivity to flowrate errors.

The chilled-water set-point temperature is chosen from Fig. 1 so that the necessary chilled-water flowrate is in the mid-range of the flow capacity. However, the flow capacity should not be greatly oversized, because it degrades the precision of the flow control. The required range of the flow controller depends on the range of heat loads and the fluctuations in the chilled-water supply temperature. The operating region shown in Fig. 1 indicates the range of flowrates required to remove different heat loads when the chilled-water temperature varies $\pm 1.0^\circ\text{C}$ about its set point. If a wide range of flowrates is required, the nonlinear effects of manipulating flowrate are more significant. An alternative solution is to vary the set-point temperature of the chilled-water supply so that the variation in flowrate is reduced when the heat load changes. Fortunately, with careful design and operation, many precision machines do have a fairly constant heat load. A large fraction of the heat often comes from pumping the coolant. It is assumed here that the temperature control system has only to provide net cooling, and never net heating. This greatly simplifies the system design and the control task.

To provide precise temperature control, the process of heat removal from the machine coolant must be closely controlled. In most applications, heat exchangers are designed for efficiently transferring heat, but for precision temperature control, accurate manipulation of small amounts of heat is most important. Therefore, the heat exchanger must be selected in a different manner from the industrial norm. For instance, if a 400 l/min flow of water requires temperature stability to $\pm 0.0001^\circ\text{C}$ under a heat load of 2.3 kW, the equivalent heat removal accuracy is only $\pm 0.1\%$ of full load. In terms of heat removal control, the temperature control problem is actually made easier with large flowrates of machine coolant. This is true because the temperature error corresponding to a given error in heat removal is smaller for larger flowrates (see Equation 1).

Many types of heat exchangers can satisfy the basic design goals of adequate heat capacity and structural integrity. However, the following factors, in approximate order of priority, must be considered in the design or selection of heat exchangers for precision temperature control:

- (1) Low sensitivity to flowrate errors
- (2) Good mixing and uniform heat transfer
- (3) Fast transient response
- (4) Ease of fabrication
- (5) Low pressure drop

Decreasing the sensitivity to errors in the chilled water flowrate is most important, because it dictates how closely the flow must be controlled. Good mixing and uniform heat transfer are next in importance because they are needed for accurately measuring the bulk temperature of the fluid. Because outlet temperature is usually sensed at one point in the outlet cross section, it may not be representative of the bulk temperature of the fluid. For example, a time-varying temperature distribution across the fluid cross section would invalidate the measurement. Experience at LLNL has shown that this

phenomenon is often the factor determining the ultimate precision of the temperature control. The third design objective is a fast transient response. The heat exchanger dynamics limit the bandwidth of the control system, which in turn determines the amount of disturbance rejection at any given frequency. Finally, the last two design objectives are carry-overs from standard heat-exchanger design practice.

Some of these design objectives conflict, but a cross-flow heat exchanger design satisfies them more than most other types of heat exchangers. They are simple to build, have well-defined flow patterns, and have a small pressure drop. Good mixing of the machine coolant occurs with it flowing on the shell side of the heat exchanger. Mixing is also promoted by avoiding oblong flow passages on the shell side and by arranging the tubes in a staggered pattern. The spacing of the tubes also influences heat transfer and mixing. To obtain a compact, fast responding heat exchanger with uniform heat transfer, a large number of small diameter tubes is necessary. The convection coefficients inside and outside the tubes and the heat load determine the size of the heat exchanger. To improve convection and enhance mixing, both the tube- and shell-side flows should be well in the turbulent flow regime. High velocities through the heat exchanger also reduce transit times of the two fluids flowing through it. This is often the dominant factor limiting the speed of response, particularly for air-to-water heat exchangers.

Methods of Heat Exchanger Control

With a flowrate-controlled heat exchanger, the chilled-water supply temperature must be stabilized by some means. If the temperature drifts from its set point, the flow controller can compensate for the deviation over a limited range. Therefore, a relatively crude, on/off controlled, commercial refrigeration unit can often be used. Typically, the water supply can be maintained to within $\pm 1.0^\circ\text{C}$ of its set point. If the fluctuations in the chilled-water-supply temperature are too large for adequate heat exchanger control, an in-line heater can be used to reduce them. Only shown in Fig. 2a, a heater can be used with any of the other heat-exchanger control techniques in Fig. 2. For precise control, however, a mixing tank should be placed in the line after the heater. Experience has shown that heaters do not uniformly transfer heat, producing slugs of hot and cold water. Heaters are typically controlled in a rapid on/off mode that simulates proportional control. The controller, heater, and additional temperature sensor are available commercially.

Manipulating flowrate allows fine control of a heat exchanger's exit temperature, but precise flowrate control is now required. The most commonly used technique at LLNL for controlling flow in heat exchangers is illustrated in Fig. 2a. Two on/off solenoid valves are employed, one normally open and one normally closed. The bypass valve opens as the supply valve closes, thus avoiding water hammer problems. The solenoid valves are operated by a controller that senses the outlet temperature of the machine coolant. Even though liquid heat exchangers are illustrated in Fig. 2, all three control techniques are equally applicable to chilled-water-cooled air heat exchangers.

If a flow controller is not precise enough, an in-line heater is often used to improve the temperature control of the machine coolant. The heater is mounted after the heat exchanger, as shown in Fig. 2a. Besides the additional hardware that is required, a heater has the disadvantages of less uniform heat transfer and a slower response time than most heat exchangers.

An alternative flow control technique using valves is shown in Fig. 2b. A manual valve has been placed in parallel with an automatic valve. The manual valve is adjusted so that the heat exchanger always provides some cooling. This technique is particularly useful if the heat loads on the system are fairly constant. With such a manual valve, the on/off transients of a solenoid valve have a smaller effect on the heat exchanger, allowing a more precise control. In addition, the response time of the heat exchanger is faster.

A manual valve is not always necessary when a proportional modulating valve is used in place of the solenoid valve in Fig. 2b. However, it may permit the use of a smaller modulating valve in its most linear range. For many proportional valves, such as gate, globe, diaphragm, or ball valves, flowrate is nonlinearly related to valve position. This nonlinearity degrades the flow controller performance. Gate valves typically provide the finest flow control and can be made linear, or even purposely nonlinear to cancel heat exchanger nonlinearities. For fast response, a motor-driven valve is used, but slower pneumatically-driven valves are also in common use. However, these valve drive mechanisms often suffer from backlash and stiction, which limits their flow control capability. These can be compensated for by sensing valve position and closing a control loop on it. However, it is even better to sense the flowrate directly and close a control loop on that. Then valve wear and all the other valve imperfections can be compensated for, before they affect the heat exchanger. This also removes the influence of valve

nonlinearity on the heat exchanger control loop.

By using a variable speed pump, as shown in Fig. 2c, the flow control problem becomes one of speed control. This is one of the fastest, most precise ways to control flowrate. There are no backlash problems with a pump, and many commercially available motor controllers have very precise speed control. Positive displacement pumps are often used, because the flowrate is directly proportional to pump speed, independent of pressure. Typically, positive displacement pumps pumping water use rubber impellers or nylon gears. However, a centrifugal pump can be used when a small nonlinearity between speed and flow can be tolerated, but then the flowrate becomes sensitive to changes in the downstream flow resistance. However, a flowmeter can be used for closed loop flow control, thereby minimizing the deficiencies of a centrifugal pump. A variety of variable speed motors are available. To be cost effective, the response time and the precision of speed regulation must be appropriate for the application. Inexpensive controllers often use only current feedback from the motor, but more precise control is possible when feedback from a tachometer or flowmeter is used. Typically, tachometers are less expensive and more accurate than flowmeters, so their use is preferable if flowrate feedback is not required for the pump deficiencies. To attain high performance, machine-tool servomotors, such as DC servomotors or variable frequency AC motors, should be used to drive the pump. These motors have response times of tens of milliseconds, which is at least an order of magnitude faster than the response time of most heat exchangers. The dynamics of the flow controller can therefore be ignored when designing the control loop for the heat exchanger.

Design of a Liquid Coolant System

An operational water temperature-control system at LLNL is described here. It serves to illustrate how such a system, shown schematically in Fig. 3, can be implemented. A constant-speed 5 HP, AC motor is used to drive a centrifugal pump that supplies 500 l/min of temperature-controlled water to a precision machine tool. The water flows through a cross-flow heat exchanger and through a 20 m long pipeline to a mixing tank 7 m above the machine. The 1000 l tank and its baffle plate encourage mixing, which tends to average out temperature fluctuations of short duration. Its thermal time constant is 120 s. The water flows by gravity out of the tank to the machine tool. After passing through the tank, the water is much more homogeneous in temperature than before it entered. The water then drains to a 2500 l sump beneath the machine from which the pump recycles it through the system.

A 2.5-HP, 2200-rpm, variable-speed DC servomotor drives a rubber-impeller pump, which can supply up to 120 l/min of chilled water to the tube side of the heat exchanger. Using tachometer feedback, the pump speed can be controlled to an accuracy of ± 1 rpm, over a 25 Hz bandwidth. The pump draws from a 1600 l water tank that is maintained at $10^\circ \pm 1^\circ\text{C}$ by a commercial, on/off-type water-chiller unit. A pump within the chiller circulates the refrigerated water to the tank and back.

The single-pass heat exchanger contains sixty 0.63-cm diameter, brass tubes, each 7.6-cm long. They are mounted in eight rows, each row staggered from its neighbor, to form a 7.6- by 7.6-cm flow passage for the machine coolant. The tube-side manifold, shown in Fig. 4, allows each half of the heat exchanger to have opposite tube flow. This tends to balance the temperature gradient across the heat exchanger. This design can transfer 2.7 kW of heat from a water flow of 400 l/min while maintaining a 20°C outlet temperature. The corresponding chilled water flow at 10°C was 100 l/min. This heat exchanger also responds quickly to changes in flowrates; its bandwidth is 0.8 Hz.

As shown in Fig. 4, a 2.5-cm thick piece of aluminum honeycomb is mounted in front of the thermistor at the outlet of the heat exchanger. The honeycomb breaks up large vortices into small eddies and smoothes the temperature fluctuations by convecting heat to and from the honeycomb walls. To encourage a uniform flow of water over the heat exchanger tubes, a plate with four cutouts is installed at the inlet to spread the flow. A similar plate is also used on the tube side to promote uniform heat transfer throughout the heat exchanger. By using these devices, a single thermistor measurement is more representative of the bulk outlet temperature of the heat exchanger.

At LLNL, thermistors are commonly used for precision temperature measurements. They have high sensitivity, excellent long-term stability, fast response, and ease of use. The thermistor beads in this system are only 0.3 mm in diameter and are bonded to the tips of glass rods which are then mounted in aluminum tubes. These thermistors respond very quickly to temperature changes in flowing water. Their thermal response bandwidth is between 10 and 15 Hz. The temperature induced change in resistance of the thermistor is measured by an AC Wheatstone-bridge circuit with a 0.00001°C resolution. The more common DC Wheatstone bridges provide resolutions ranging from 0.001 to 0.01°C .

Closed-Loop Control Techniques

A number of techniques can be used to close feedback control loops on heat exchangers. Most are commercially available, so the type of controller chosen must be cost effective for the desired level of temperature control. The simplest and most inexpensive controller is an on/off type with an adjustable deadband. The deadband is adjusted so that the nominal on/off cycle time is short compared to the response time of either the machine being cooled, or of a mixing tank located after the heat exchanger. However, this method provides precise temperature control only if the chilled water temperature and the system heat loads are relatively constant. A duty-cycle offset occurs in the machine-coolant temperature if the ratio of on to off periods changes greatly. This type of control, in conjunction with in-line heaters (Fig. 2a), has achieved a $\pm 0.01^\circ\text{C}$ temperature stability in a 160 l/min oil flow.^{1,2} This temperature was averaged over a 30 s period, because the cycle time of the solenoid valves was nominally 6 s, which is much faster than the response time of the machine being cooled.

Duty-cycle offset can be corrected if a proportional plus integral (PI) controller is used. The output of a PI controller is typically a voltage signal that is proportional to the amount of flowrate required for temperature control. For an on/off device like a solenoid valve, this voltage signal can be converted to a time-proportioned output that cycles the valve's on and off periods in proportion to the controller output. If the cycle time is short compared to the response time of the heat exchanger, this technique effectively mimics the proportional control of flowrate. However, very durable solenoid valves are required to withstand the frequent on/off cycles. Microprocessor-based PI controllers are commercially available with time-proportioned outputs. Some other digital controllers offer more flexibility than analog controllers, such as nonlinear compensation and averaging of multiple temperature sensors.

The inner feedback loop of the block diagram in Fig. 5 shows how a PI controller can command a motor-speed controller to obtain flow control. Because the temperature-control set point is fixed, the sole purpose of the feedback control is to provide disturbance rejection. Most system disturbances, such as chiller cycling or changing heat loads, are ramp functions. These induce a steady-state following error in a PI-controlled system. To maximize disturbance rejection, the PI controller must be tuned to maximize the open-loop gain of the system at low frequencies, while an adequate stability margin is maintained. Most heat exchangers respond slow enough that many commercially available digital controllers can provide precise temperature control. However, analog controllers are still widely used.

In the system shown in Fig. 3, the machine and the heat exchanger are separated by a 35 m long pipeline and a 1000 l tank. The coolant is well mixed at the machine, but it is subject to additional environmental heat loads. Therefore, closing a feedback loop with temperature sensed only at the heat exchanger was not adequate, and sensing temperature at the machine makes the control system too slow for disturbance rejection. Therefore, an inner control loop was closed at the heat exchanger, and its set point was commanded by another control loop sensing temperature at the machine. A block diagram of this configuration is shown in Fig. 5. This cascaded outer loop compensates for inner-loop following errors and for errors in the inner-loop bulk-temperature measurement. The outer loop is much slower than the inner loop, therefore, it is only capable of low frequency corrections. The final closed-loop performance of the system is recorded in Fig. 6. This temperature record was made at the machine after being filtered by a single-pole filter. The filter had a time constant of 160 s, emulating the fastest thermal response of any machine component. This $\pm 0.0002^\circ\text{C}$ temperature stability is typical and is independent of the 1.5°C variations in chilled water temperature. Without the outer loop closed, the inner loop thermistor could be stabilized to $\pm 0.00002^\circ\text{C}$, but the coolant temperature at the machine only indicated $\pm 0.002^\circ\text{C}$ stability. This demonstrates the sensitivity of the single-loop control system to chiller cycling, errors in the bulk temperature measurement, and to environmental heat loads occurring after the heat exchanger.

Design of an Air Conditioning System

Many of the principles of liquid-temperature control systems apply to air conditioning systems as well. However, air is more difficult to control than liquids because of its lower heat capacitance, and the larger volumes of coolant. Air cooling systems typically operate with higher heat loads than liquid systems because of the energy required to move large volumes of air. Air also does not convect heat as well as liquids, necessitating larger, more difficult to control heat exchangers. It is also more difficult to control the temperature of a machine using air showers, as opposed to oil showers. Careful attention must be given to the flow distribution over the machine, which must be uniform, of high velocity, and time invariant. Radiation heat transfer to the surroundings also degrades the temperature control of the machine.⁷

An example of a high-performance air-conditioning system at LLNL is shown in Fig. 7. The air is drawn in through a filter box and passes through a cross-flow, air-to-water heat exchanger. A centrifugal fan, driven by a 25 HP motor, is placed after the heat exchanger to deliver an air flow of up to 570 m³/min. This fan is the largest heat load in the system, raising the air temperature by 1°C. As a consequence, only cooling is required throughout the year. A duct connects the fan to a 0.5-m deep plenum covering the entire ceiling of the 6- by 6-m machine enclosure. With a nominal velocity of 15 m/min over the machine, the flow of 20°C air is laminar, and is also comfortable for the operator. The air exits through gratings at the perimeter of the enclosure. This enhances cooling of the heavily insulated walls and minimizes the thermal coupling of people to the machine. A raised floor allows the air to pass into a pit below the machine, from which it returns to the filter box through a stairwell. The enclosure is slightly pressurized to avoid inward leakage of outside air, and it force cools the fluorescent ceiling lights with air leaving the machine enclosure. Make-up air is drawn into the system from a point near the stairwell.

The variable-flow, chilled-water supply for the air-to-water heat exchanger is identical to the system shown in Fig. 3. The heat exchanger was designed to minimize its water volume, thereby decreasing its response time. The 1.2-m tall, by 1.5-m long, by 6.4-cm thick heat exchanger has 4 parallel aluminum fins per centimeter. These are attached perpendicularly to twentyeight 1.0-cm diameter copper tubes running down and back through the fins. This two-pass heat exchanger design tends to even out the temperature gradient across its face. The ends of these tubes are connected to a supply and return manifold, respectively. The large number of small-diameter tubes encourages uniform heat transfer. Locating the fan after the coil serves to mix the air flow, and compensates for any uneven cooling that may result from uneven air flow across the heat exchanger. A cascaded control technique similar to that shown in Fig. 5 is used. The air temperature for the inner loop is measured at a single point in the 1.2- by 1.5-m duct downstream of the fan. The large duct cross section makes bulk temperature measurements more difficult. The air temperature for the outer loop is measured in the machine enclosure directly above the machine. PI controllers are used for both the inner and outer loops, but the inner-loop bandwidth is only 0.01 Hz, because of the large heat exchanger. The performance of the air system is measured with 10 thermistors distributed throughout the machine enclosure. The unfiltered, 10-thermistor average over 36 hours is shown in Fig. 8, demonstrating the $\pm 0.002^\circ\text{C}$ temperature stability of the system.

Conclusions

This paper highlights the practical techniques and principles of obtaining precision temperature control in liquids and air. These include:

- (1) Minimizing heat load variations and decreasing their rate of change
- (2) Increasing the thermal response time of critical machine components
- (3) Using large flowrates of coolant
- (4) Selecting the proper variable-flowrate heat exchanger for the application
- (5) Using a method of flow control that is appropriate to the application
- (6) Encouraging mixing to improve bulk temperature measurements of the machine coolant
- (7) Using a proportional plus integral action controller for improving temperature control precision
- (8) Employing cascaded control loops for improving disturbance rejection

Acknowledgements

I would like to thank the following for their help in the preparation of this document: Steve Greenberg, Patricia Flowers, and Linda Sarginson.

Auspices

Work performed under the auspices of the U.S. Department of Energy by the Lawrence Livermore National Laboratory under Contract No. W-7405-ENG-48.

References

1. J. B. Bryan, R. R. Donaldson, E. R. McClure, and R. W. Clouser, "A Practical Solution to the Thermal Stability Problem in Machine Tools," S.M.E. Technical Paper, Dearborn, Michigan, No. MR72-138, 1972.
2. J. B. Bryan, D. L. Carter, R. W. Clouser, and J. H. Hamilton, "An Order of Magnitude Improvement in Thermal Stability with Use of Liquid Shower on a General Purpose Measuring Machine," S.M.E. Precision Machining Workshop, June 6-10, 1982, St. Paul, Minnesota, No. 1082-936.

3. E. G. Loewen, "Air Shower Thermal Stability," Bausch & Lomb, Rochester, NY, For Presentation at SME Precision Machining Workshop, Williamsburg, VA June 27-29, 1978.
4. E. R. McClure, Manufacturing Accuracy Through the Control of Thermal Effects, Thesis, Lawrence Livermore National Laboratory, UCRL-50636, Livermore, California, 1969.
5. H. J. Hansen, "Techniques For Precision Air Temperature Control," SPIE 27th Annual International Technical Symposium & Instrument Display, San Diego, California, August, 1983.
6. R. R. Donaldson and the Machine Tool Development Group, "Large Optics Diamond Turning Machine Technical Report, Work Performed through December 1, 1980," Lawrence Livermore National Laboratory, UCAR-10075-1, Livermore, California, April, 1981.
7. H. E. Collicott, L. L. Hartter, "Thermal Effects in the Manufacturing Process," Presented at the National Bureau of Standards Conference on Dimensional Accuracy in Manufacturing, Gaithersburg, MD., Oct. 30-Nov. 1, 1972.



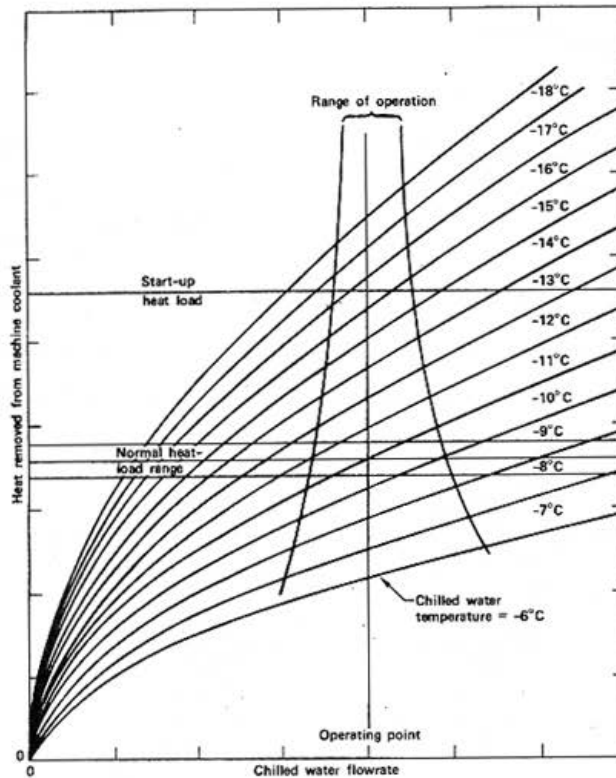



Fig. 1. Steady-state heat transfer characteristics of a heat exchanger.

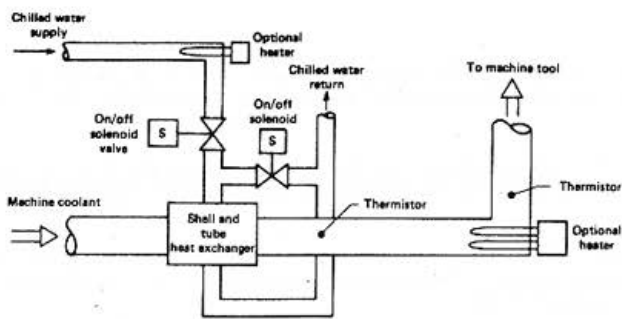

a) Most common technique.

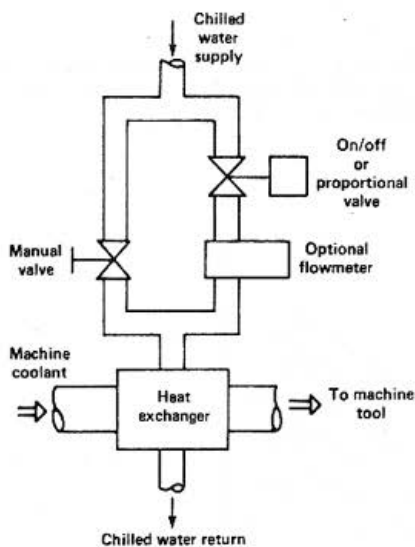

b) More precise technique.

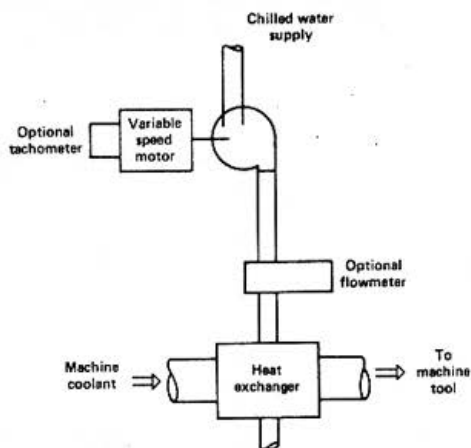

c) High precision technique.

Fig. 2. Temperature control techniques using heat exchangers.

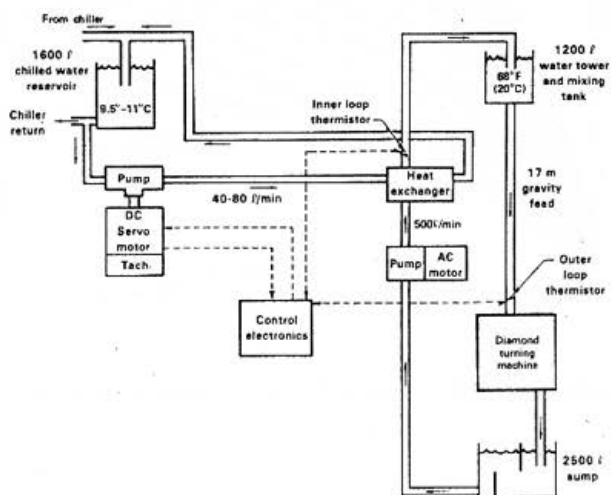


Fig. 3. A water temperature control system.

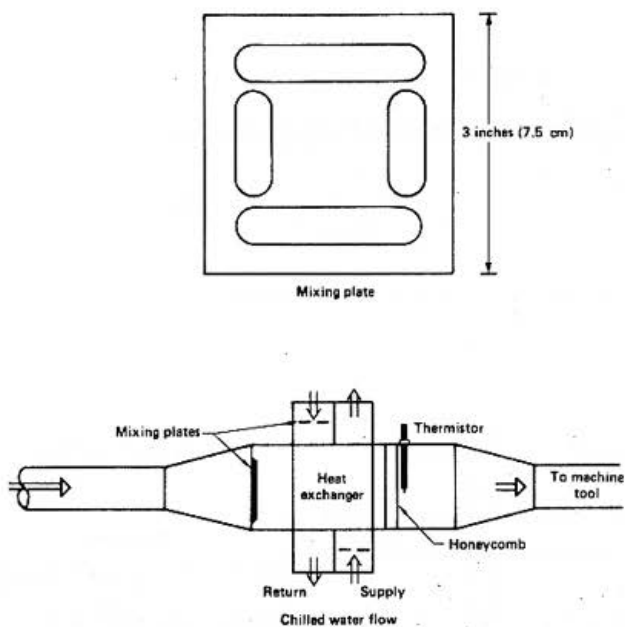


Fig. 4. Schematic diagram of water flow paths through the heat exchanger.

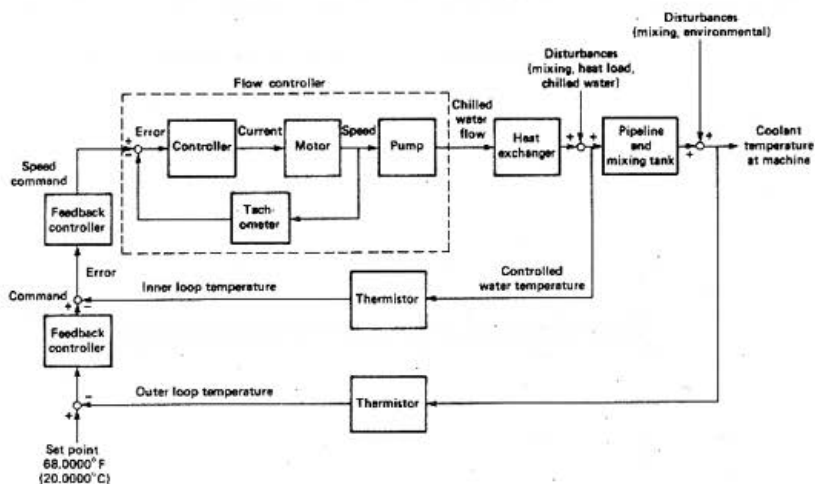


Fig. 5. Block diagram of the feedback control loops.

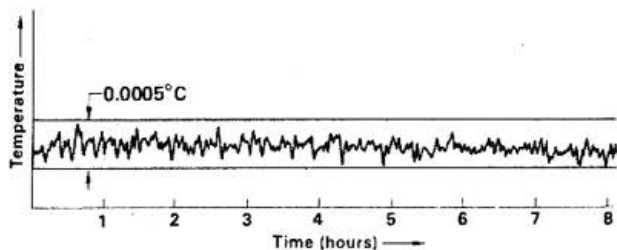


Fig. 6. Stability of the water temperature control system.

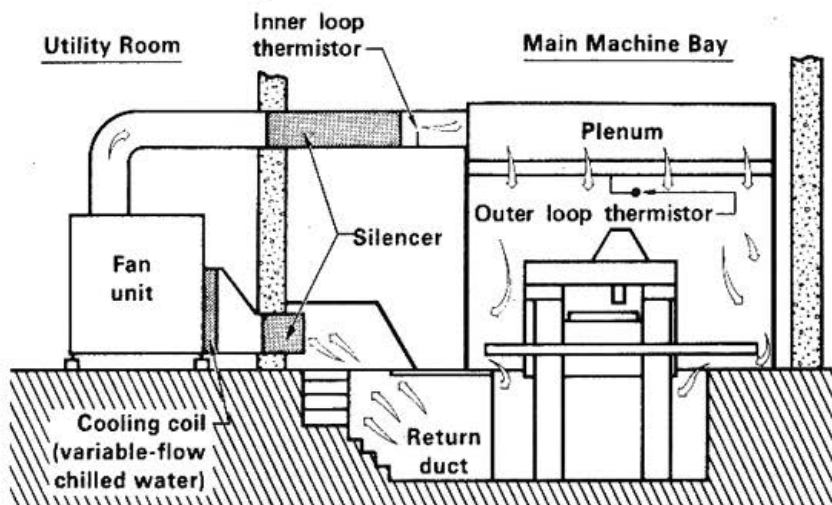


Fig. 7. A machine enclosure and air conditioning system.

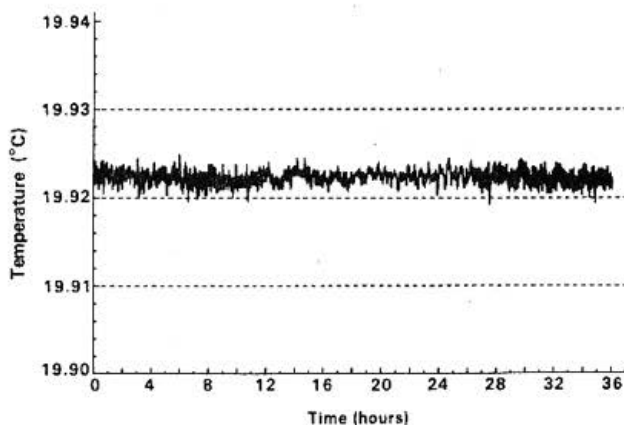


Fig. 8. Ten thermistor average temperature in the machine enclosure.

